

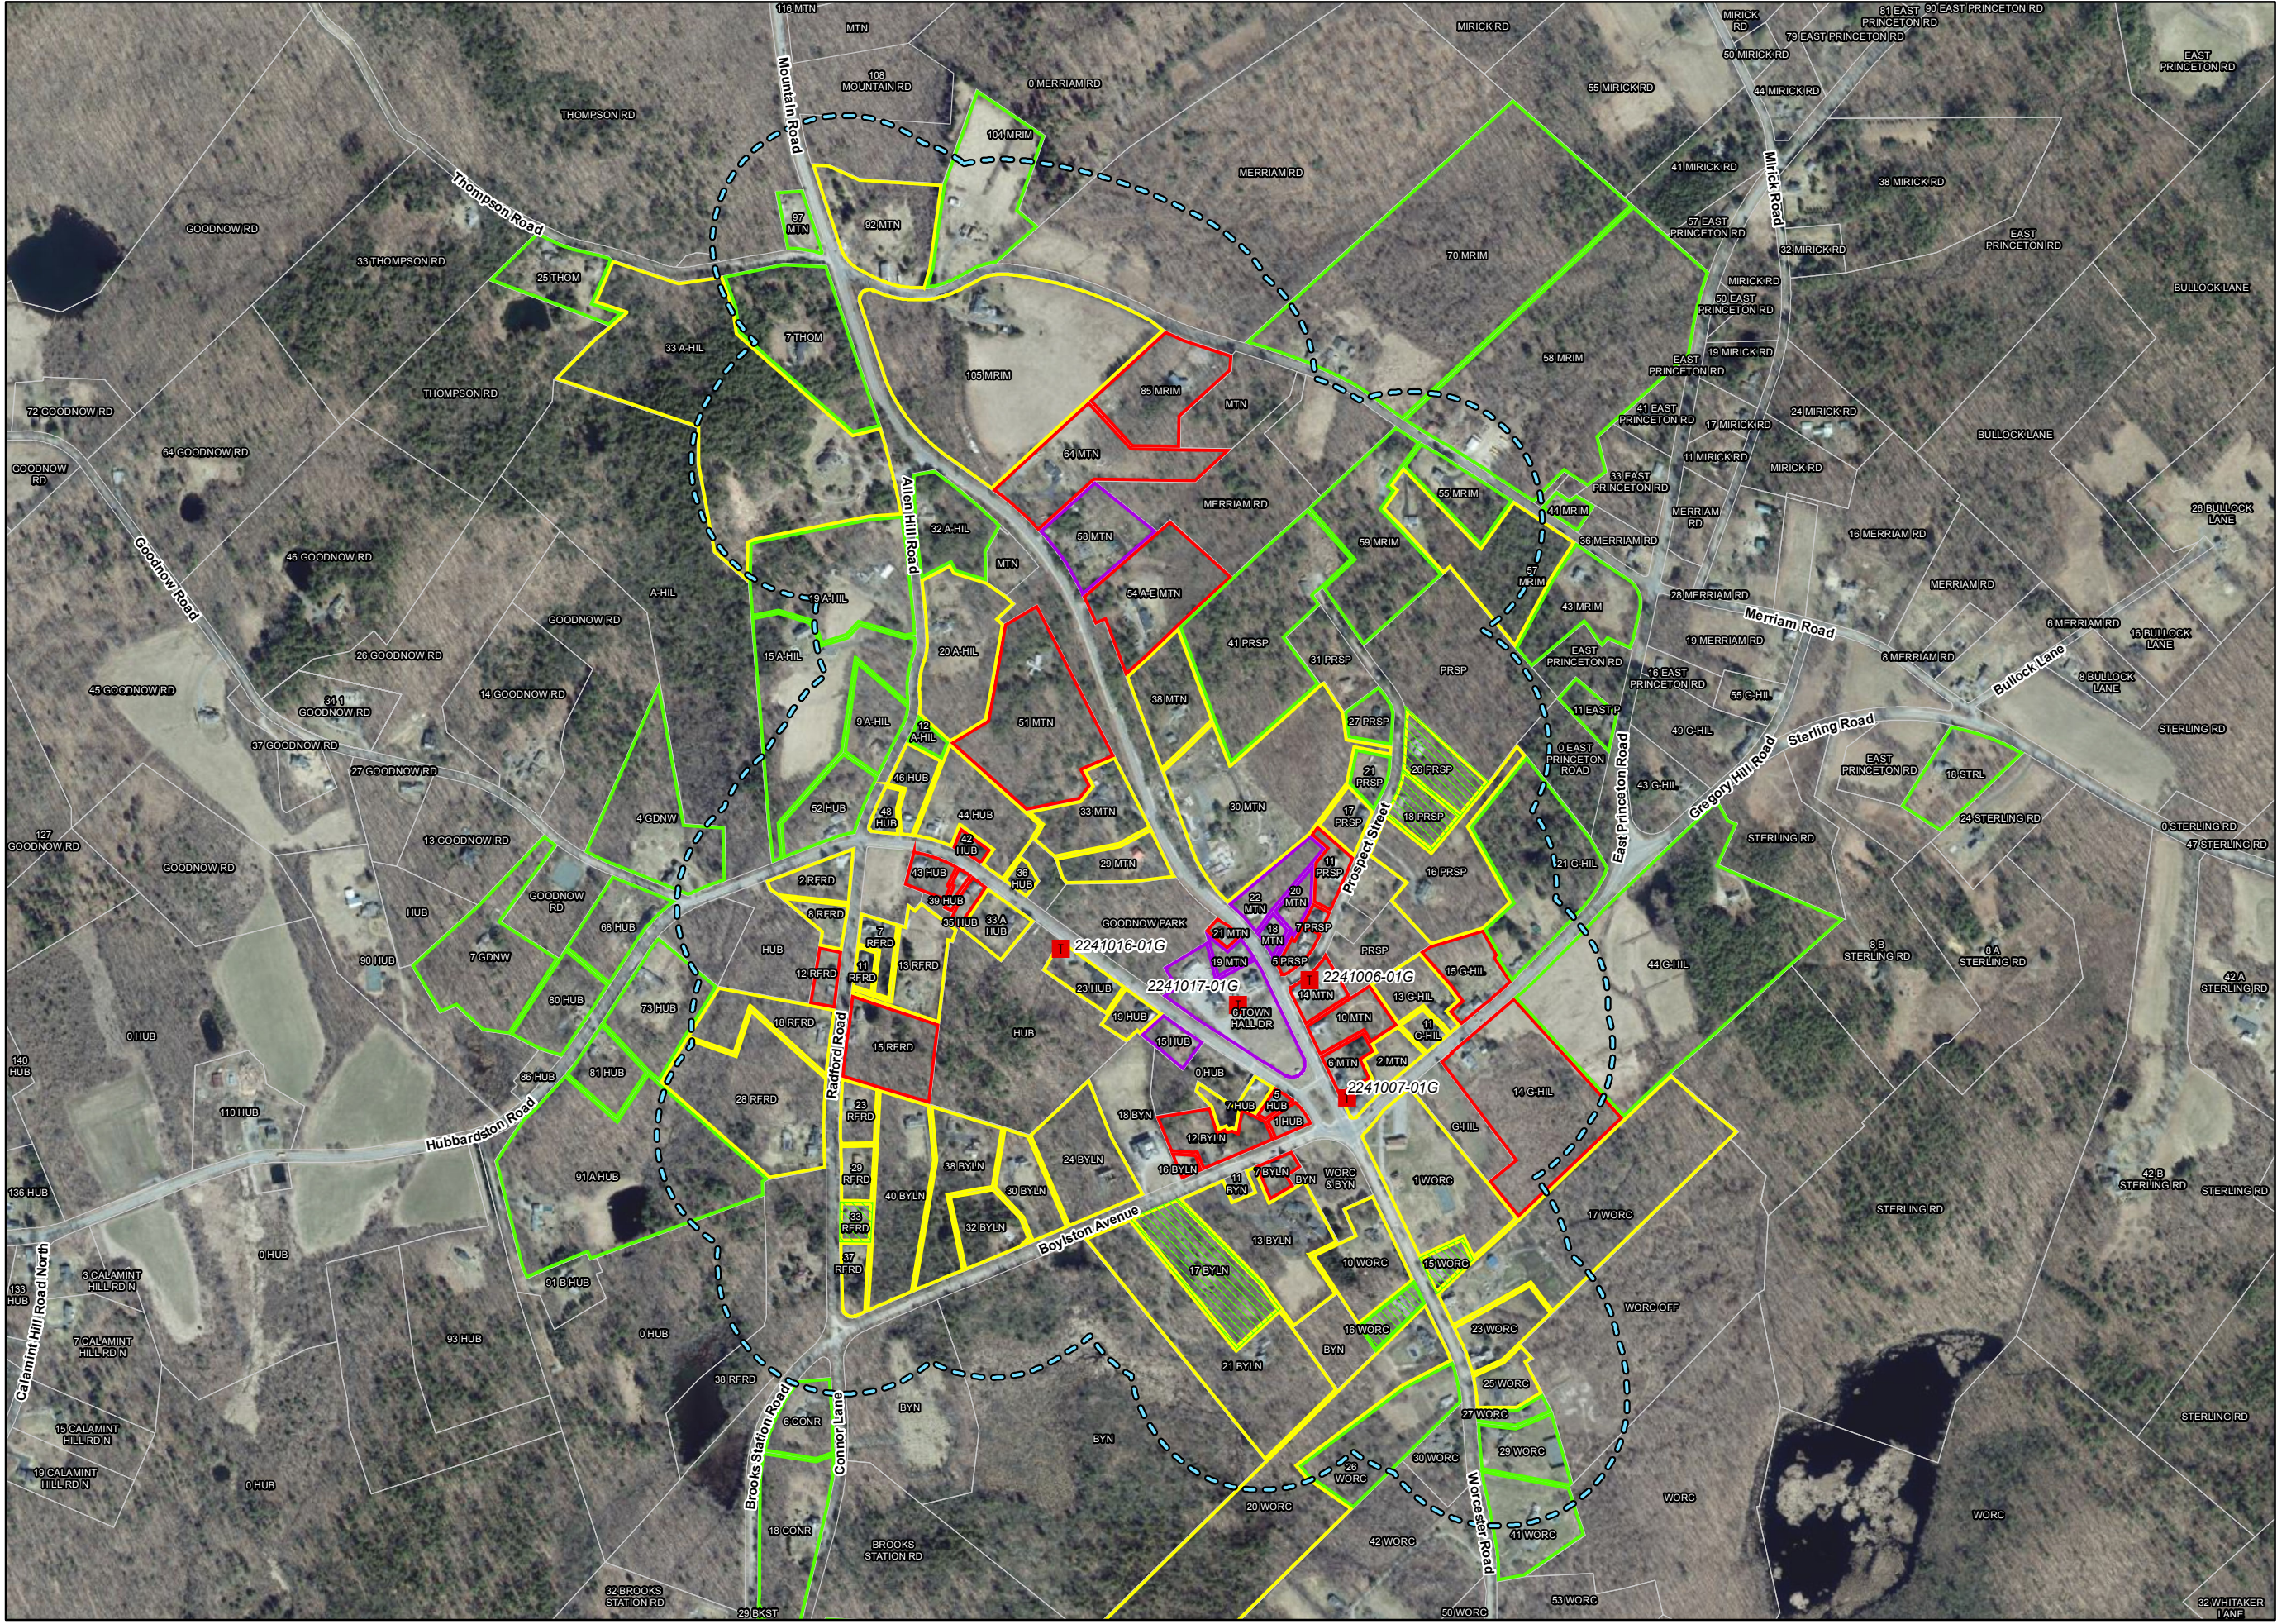


FIGURE 3
AERIAL RADIUS MAP
AND DISPOSAL SITE
BOUNDARY

LEGEND



Total Regulated PFAS Concentrations in Parts-Per-Trillion (ppt)

- Greater Than 90
- Greater Than 20 But Less Than 90
- Less Than 20
- Non Detect (RL*)
- Non-Community Transient Public Water Supply

500' Radius (2024/01/03)

Property Using Bottled Water

*Laboratory Reporting Limits (RL) varied from 1.7 to 4.0 ng/L

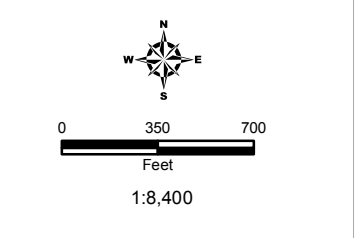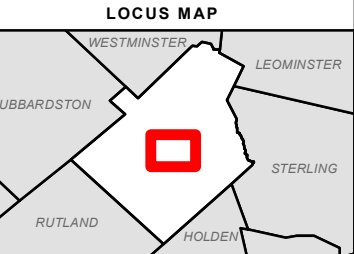

NOTES

1. Based on MassGIS Orthoimagery (2019)
2. 500' Buffer based on a 50' buffer of building structures. Well locations are assumed to be within 50' of each home.
3. Abbreviation Dictionary:
"ALLEN HILL RD": "A-HIL"
"BOYLSTON AVE": "BYLN"
"GREGORY HILL RD": "G-HIL"
"HUBBARDSTON RD": "HUB"
"EAST PRINCETON RD": "EAST P"
"MOUNTAIN RD": "MTN"
"PROSPECT ST": "PRSP"
"RADFORD RD": "RFRD"
"WORCESTER RD": "WORC"
"MERRIAM RD": "MRIM"
"GOODNOW RD": "GDNW"
"CONOR LN": "CONR"
"GREGORY RD": "GRGY"
"STERLING RD": "STRL"
"RALPH RD": "RLPH"
"THOMPSON RD": "THOM"
"TOWN HALL DRIVE": "T-HALL"

RTN 2-21072
PRINCETON, MASSACHUSETTS
January 2024

